TILT II & QUICK-CHECK®

TRANSFORMER & CAPACITOR TESTERS

WITH AUTOMATIC SELF TEST

Operating & Instruction Manual





99 Washington Street
 Depot Melrose, MA 02176
 Phone 781-665-1400
 Toll Free 1-800-517-8431



Visit us at www.TestEquipmentDepot.com

TILT II & QUICK-CHECK

TRANSFORMER & CAPACITOR TESTERS

WITH AUTOMATIC SELF TEST

IMPORTANT SAFETY INFORMATION
OPERATING INSTRUCTIONS
PRE-USE INSPECTION
TESTING SINGLE PHASE TRANSFORMERS
TESTING CAPACITORS
TESTING THREE PHASE TRANSFORMERS
TESTING DISTRIBUTION VOLTAGE REGULATORS
TESTING DISTRIBUTION TRANSFORMERS FROM METER SOCKETS8
CARE AND MAINTENANCE
REPAIRS
TECHNICAL SPECIFICATIONS
TERMS AND CONDITIONS OF SALE



IMPORTANT SAFETY INFORMATION

WARNING: The TILT II and Quick-Check Transformer and Capacitor Testers should be used only on equipment known to be deenergized and/or discharged.

CAUTION: Use on the secondary side of transformers may generate high voltages on the primary side. Stay clear of all primary connections while testing.

The Quick-Check Transformer and Capacitor Testers will not leave a significant charge on a capacitor.

OPERATIONAL IMPAIRMENT: If the Testers are used in a manner not described in this instruction manual, the protection and effective operation of this equipment may be impaired.

INTRODUCTION

The TILT II and Quick-Check Transformer and Capacitor Testers are versatile tools for quick and easy checks of transformers and the connections made to them. The Quick-Check Transformer and Capacitor Tester also tests power capacitors and capacitor banks. The transformer connections can include bundled secondaries or a cable run from the transformer to the meter.

In the field, the testers are used to test the primary and secondary sides of new or reworked, single or three phase transformer installations. The Quick-Check Transformer and Capacitor Tester also tests capacitor banks for short or open circuits prior to energizing.

In the shop the testers are used for quick screening of incoming and outgoing transformers (including their internal fuses and breakers). The Quick-Check Transformer and Capacitor Tester also tests capacitors for both shorts or opens. Both testers test 1Ø and 3Ø transformers including PT's and other instrument transformers, and the Quick-Check Transformer and Capacitor Tester tests power capacitors in almost any size.

HOW THEY WORK

The Testers are used in the field for testing connected transformers, their connected primary and secondary leads and the Quick-Check Transformer and Capacitor Tester for power capacitors, individually or in banks, for both shorts or opens. Unlike a simple ohmmeter, the Testers use a high frequency, low voltage signal to measure transformer winding inductance (and power capacitor capacitance) and they can differentiate true shorts from other low resistance windings or connected equipment such as meters. NOTE: The TILT II and Quick-Check Transformer and Capacitor Testers will not detect a partially shorted transformer coil or an improper transformer ratio. They will not detect a capacitor with a partial short or open.

PRE-USE INSPECTION

The Testers will automatically perform a self-test of the battery, lights and beeper every time the TEST button is pushed. This self-test takes about one second to complete, after which the tester will begin testing whatever the leads are connected to. This self-test does not test the test leads and internal fuse. To test the leads and fuse, short the test leads together and press the TEST button. A rapidly blinking SHORT light after completion of the normal self-test indicates that the leads and fuse are good.

If the unit fails to operate, check or replace the battery. If this self-test is not completed, the unit will not perform any further testing and must be returned to the factory for service.

TESTING SINGLE PHASE TRANSFORMERS


For single phase transformers, use these figures as guidelines to get started. For 3Ø transformers, the test leads are connected from each phase to neutral and across each pair of phases. When all connections are proper and the transformer itself is good, the Tester will beep and show TRANSFORMER O.K. The OPEN indication designates a bad connection or an open transformer winding. A SHORT indication designates a short from phase to neutral or phase to phase in the transformer or the connections to it.

NOTE: Disconnect primaries or remove primary fuses before testing secondaries.

For the Quick-Check Transformer and Capacitor Tester and power capacitors. tests across the two bushings should show CAPACITOR O.K. On a single bushing capacitor tests from bushing to ground will also show CAPACITOR O.K. On a two bushing capacitor, tests from bushing to ground should show OPEN.

As a quick test in the shop, the Testers can be used to screen transformers by checking both primary and secondary windings and connections. Test for SHORTs on both primary and secondary windings and from primary to secondary. Test for OPENs on both primary and secondary windings to check for open windings or open breakers and fuses. Tests for power capacitors with the Quick-Check Transformer and Capacitor Tester are performed across each bushing and from bushing(s) to ground.

Test Connections

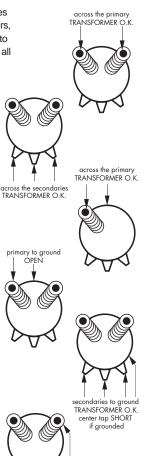



from primaries to secondaries OPEN

TRANSFORMER O.K. if both primary and secondary have one grounded bushing

TESTING CAPACITORS

These instruments are intended for quick and simple testing of transformers or capacitors and the connections made to them. Do not energize visibly damaged equipment such as a transformer leaking oil or a bulged capacitor even if the Tester gives an O.K. reading.

The Testers are powered by an internal 9V lithium or alkaline battery. It is easily and quickly replaced by removing the battery cover on the back of the unit.

WARNING: The Testers should be used only on equipment known to be deenergized and/or discharged.

CAUTION: Using the Testers on the secondary side of transformers may generate high voltages on the primary side. Stay clear of all primary connections while testing.

The Quick-Check Transformer and Capacitor Tester will not leave a significant charge on a capacitor.


NOTE: For user safety there is a non-replaceable 600V internal fuse inside the instrument. If the instrument is connected to an energized transformer, the fuse will blow. The instrument must then be returned to the factory for repair.


TESTING THREE PHASE TRANSFORMERS


The TILT II and Quick-Check Transformer and Capacitor Testers should be used only on equipment known to be deenergized.

Using the Testers on the secondary side of transformers may generate high voltages on the primary side. Stay clear of all primary connections while testing.


Test Connections for Quick-Check Transformer and Capacitor Testers Only








For 3Ø transformers, the test leads are connected from each phase to neutral and across each pair of phases. When all connections are proper and the transformer itself is good, the Tester will beep and show O.K. The OPEN indication designates a bad connection or an open transformer winding. A SHORT indication






Primary Secondary

For Y (wye) connections, test the primary and secondary sides of the transformer as follows:

X1 - X2	Transformer O.K.	X2
X2 - X3	Transformer O.K.	^2
X1 - X3	Transformer O.K.	ک ے
X1 - X0	Transformer O.K.	>
X2 - X0	Transformer O.K.	>
X3 - X0	Transformer O.K.	_
H1 - H2	Transformer O.K.	\subseteq
H2 - H3	Transformer O.K.	
H1 - H3	Transformer O.K.	W, XO W
H1 - H0	Transformer O.K.	4
H2 - H0	Transformer O.K.	•
H3 - H0	Transformer O.K.	X1 X3
H1 - X1	Transformer O.K. if both H0	Y Connection
H2 - X2	and X0 are grounded,	r Connection
H3 - X3 🕽	otherwise OPEN	
H0 - X0	SHORT, if both sides are grou	unded, otherwise OPEN

For Δ (delta) connections, test the primary and secondary sides the same as the Y (wye) except omit the connections to X0 and H0.


The TILT II and Quick-Check Transformer and Capacitor Testers will not detect a partially shorted transformer coil or an improper transformer ratio. They are intended for quick and simple testing of transformers and the connections made to them.



Delta Connection

TESTING DISTRIBUTION VOLTAGE REGULATORS

For typical distribution voltage regulators, test using these figures as guidelines. Both the line and load bushings tested to ground should indicate the reading shown in the figures. With the regulator in the neutral position, the line and load are internally connected with the resulting load to ground TRANSFORMER OK test indicating SHORT.



line to ground TRANSFORMER OK

TESTING DISTRIBUTION TRANSFORMERS FROM METER SOCKETS

An overhead or underground distribution transformer can sometimes be more conveniently tested from a meter socket served by that transformer.

The TILT II and Quick-Check Transformer and Capacitor Testers should be used only on equipment known to

be deenergized. Test both the load and source sides of the meter socket for the presence of voltage before using the Tester.

Using the Tester on the secondary side of transformers may generate high voltages on the primary side. Stay clear of all primary connections while testing. The Quick-Check Transformer and Capacitor Tester will test the secondary side of a transformer connected to the meter socket. Connect the Tester across the two source side receptacles and from each receptacle to ground and test.

NOTE: This procedure will not work if other loads are connected to the same transformer.

The wiring on the load side of the meter socket going into the main breaker can also be tested for shorts or crossed phases. Connect the Tester across the two load side receptacles and from each receptacle to ground. The absence of shorts or crossed phases will be indicated by an OPEN reading. If the main breaker is not open, connected loads within the building may cause a SHORT or TRANSFORMER O.K. indication.

The meter socket connections shown are typical. Local standards may specify different connections.



CARE AND MAINTENANCE

STORAGE - It is recommended for protection of the TILT II and Quick-Check Transformer and Capacitor Tester that it is stored in the carrying case.

CLEANING INSTRUCTIONS - To clean, wipe with a damp cloth with water. Do not use harsh chemicals or solvents.

DAMAGE - If you suspect any mechanical or electrical damage, do not use and arrange for repair by returning to the factory.

 $\label{lem:calibration} \textbf{CALIBRATION \& TESTING -} \ \textbf{Regular calibration is not required.} \ \textbf{There is no calibration adjustment.}$

WARNING: Use Only on Equipment Known to be Deenergized and/or Discharged Automatic self test operates with each use. Check for lights and beeper when green light is on. To test leads and internal fuse, short leads together and verify blinking SHORT light.

Connect the test leads to the device under test. Push the test button and observe the lights. An OK indication verifies no direct shorts or opens. OPEN indicates an open connection or high resistance leakage path. SHORT indicates a very low resistance. Using this tool on the secondary side of transformers may generate high voltages on

the primary side. Stay clear of all primary connections while testing. Test transformers across all primary and secondary connections and from primary to secondary. Refer to instructions. Check the battery if unit fails to operate. Replace with 9V alkaline or lithium types. Contains a 600V fuse which is not replaceable. Return to factory for service. Maximum output voltage 6VDC.

DANGER: Failure to follow these directions or the instructions may expose the user to high voltage, severe injury or death. HD Electric Company, Waukegan II. USA www.HDElectricCompany.com US Patent 6,130,530 4/16 TL-AST-N, TL-AST-M, QC-AST-M

TECHNICAL SPECIFICATIONS

MODELS

TL-AST-N, TL-AST-M, QC-AST-N, QC-AST-M

DIMENSIONS

3.6 in. W x 5.7 in. L x 1.2 in. H (9.1 cm x 14.5 cm x 3.0 cm)

WEIGHT

TL-AST-N / QC-AST-N - 1lb.,1oz. (0.47 kg)

TL-AST-M / QC-AST-M with magnet - 1lb., 2 oz. (0.51 kg)

BATTERY

9V alkaline ANSI 1604A, IEC 6LR61 or 9V lithium ANSI-1604LC

OUTPUT VOLTAGE: 6VDC maximum pulsed at 50Hz nominal

SHORT: $\leq 10\Omega$, varies with battery voltage

OPEN: $\geq 10\Omega$, varies with battery voltage

TRANSFORMER O.K.: minimum inductance 800µH

CAPACITOR O.K.: (Quick-Check Transformer and Capacitor Tester only)

minimum capacitance 0.5µf maximum capacitance 300µf

AUDIO OUTPUT: 85db at 30cm

ENVIRONMENTAL CONDITIONS

CONDITIONS: Indoor and outdoor use

ALTITUDE: Up to 6,566 ft. (2000M)

OPERATING TEMPERATURE: -20°F to +140°F (-29°C to +60°C)

HUMIDITY: 95% to +60°C (non-condensing)

POLLUTION DEGREE: PD2

ENCLOSURE MATERIAL: ABS UL 94-HB

OVERVOLTAGE CATEGORY: II Non-contact

PRINTED CIRCUIT BOARDS: FR-4 UL 94-V0

BATTERY REPLACEMENT INSTRUCTIONS

To replace the battery, open the compartment on the bottom of the housing. Remove and dispose of the old battery, replacing it with a fresh, new 9-volt lithium or alkaline battery.

MANUFACTURING LOCATION

HD Electric • Southaven, MS, 38672 USA

TERMS AND CONDITIONS OF SALE

NO Exercic Company is been referred to either as THOE or "Selet" and the custom or person or entity purchasing goods or services Derevalities collectivity represent to as "Coodil") is referred to as "Foodil" is

PROCES AND TAXES: Unless a fixed price is quieted, the price at which this order is accepted is subject to adjustment to INDE's price in effect at the time of order. Any current or future tax or governmental change (or increase in same) affecting Selfer's costs or production, sale or delivery or which Selfer is otherwise required to pay or collect in connection with the sale, purchase, delivery, storage, processing, use or consumption of Goods (but evoluting any two soffers in entircome or polity) shall be for Supris, account and shall be added for the price.

2. TEMBS OF PAYMENT. Terms are stated on 14DE's incide in U.S. currecy, HOE shall have the right, among other emedies, either to berminate this agreement in suggested that the property of th

3. SEPMENT AND DELIVERY: Uries otherwise expressly provided, shipments are made F.O.B. H.DE's shipping point. Risk of loss or damage and responsibility shall pass from HOE to Buyer upon delivery to acromous carrier. Any dams for inchanges or damages unless of the manual see the responsibility of Buyer and sail be authentically the Buyer desety to the carrier. Shartages or damages must be acknowledged and speed for a feet thereof devices, when the Buyer deset is a relation of the second commercial and a relation to the second commercial and a relation to the second commercial and a relation of the second commercial and a relation to the second commercial and a relation of the se

S. LIMITATION OF RENETY AND LIABILITY. THE SOLE AND EXCLUSIVE REMEDY FOR BREACH OF ANY WARRANTY HERRUNDER SHALL BE LIMITED TO REPAIR, CORRECTION, REPLACEMENT OR CREET UNDER SECTION 4 NEW SHALL FOR ELIMITED TO REPAIR, CORRECTION, REPLACEMENT OR MINE CONTROL AND INDIVIDE AND INDI

4. EXCUSE OF PERFORMANCE (PROCE MACRUER): HOE data for to label for delay in performance of the 10-start of to last of Code, and of Spars, and facilities are for the control of the code of the code

7. CHANGES: HDE reserves the right to change designs and specifications for standard Goods without prior notice to Buyer, but not with respect to custom Goods being made for Buyer. HDE shall have no obligation to install or make such change in any Goods manufactured prior to the date of such change.

8. ASSIGNMENT: Buyer shall not assign its rights or delegate its duties hereunder or any interest herein without the prior written consent of HDE, and any such assignment, without such consent, shall be void.

9. INSTALLATION: Buyer shall be responsible for receiving, inspecting, testing, storing, installing, starting up and maintaining all Goods.

19. INSPECTION/TESTING: Buyer at the experse, agrees that will promptly inspect the Crods upon receipt threed, and in no event later than thin; (30) days from the date of receipt of the Crods. Buyer shall deliver to PIDE with filters (15) agos of respector, but it no even later than thor; the (5) days from the 6 set of the Crods of the Crods, within routice of any and delideracine, delinition from specialization comparising of any kind will respect to the quantity, quality, contition, objective, preferrance, price or appearance of the Crods so received by Buyer. In the event no such vinition are report received by Indice. Buyer and in order to the control of the Crods cont

11. SERVICEs: If this agreement requires HDE to perform or provide any services, HDE (including without limitation its successors, assigns, agents or any person or entity acting at HDE's direction) shall not be responsible for any damages, claims, liabilities or expenses of any nature arising out of such services.

12. U.S. EXPORT CONTROL LAWS: All Goods sold to Buyer by HDE hereunder are subject to U.S. Export Control Laws. Buyer hereby agrees not to re-sell or divert any goods contrary to such laws

13. COMPLIANCE: Select/Directors that comply with all agriculture feetent, state or local teas, rules, regulations, or orders. Select/Directors that comply with all applicable feetent, states or local teas, rules, rules, regulations, or orders. Select/Directors order Selectors order orders order orders orders

14. MSCELLARCOUS: These terms and conditions supersedue all other communications, negotiations and prior or of or writer statements regarding the subject natural reviews of the statement and ordinations super statements and statements of the statements and statements of the statement of the statements and statements and

15. DISPUTE RESOLUTION: In the event of any dispute NACLIDING, BUT NOT LIARTED TO, SERGACH OF CONTRACT, BREACH OF O'WARRANTY, CAUMS SASKED IN TORT, NEGLIGENCE, PRODUCT LIABLITY, PRODUCT LIABLITY, PRODUCT LIABLITY, AND THE WARRANTY, AND THE WARRAN

16. CLASS ACTION WARKER, BIDDING ARRITATION MUST BE ON AN NONVIOUAL BASIS. THIS MERA'S INTHIFRE BUYER NOR SELER MAY JOIN CONSOLIDATE CLAMBS IN ARRITATION TO A CAMBISTA THE TAY CLAMBS AS A REPRESENTATIVE OR MEMBERS OF A CLASS OR IN A PRIVILE ATTORNEY CREMENT, ACADITY, ADMINISTRATION OF AR-BITHATION TO A MEMBERS AND A CHARLES AND A SERVICE AND A CLASS AS A REPRESENTATIVE OR MEMBERS OF A CLASS OR IN A PRIVILE ATTORNEY CREMENT, ACADITY, ADMINISTRATION OF AR-BITHATION OF A CLASS OR IN A PRIVILE AND A CHARLES AND A CHARL

HD Electric Company is committed to ongoing review and improvement of its product lines, and thus reserves the right to modify product design and specifications without notice.

HD Electric Company® products are available through HDE® sales representatives worldwide.
HD Electric products receive final assembly and shipment from HDE's production facility at
Suite 400 - 4320 Executive Drive, Southaven, MS 38672.

HD Electric Company is ISO 9001:2015 certified

Printed in U.S.A. © HD Electric Company 2020 • Bulletin No. TILT/QC AST IM-200a